


Clearance envelope for grain bins filled by permanently installed augers, conveyors or elevators

- P** = Probe clearance
5.5m (18 ft) required by Rule 234F1a
- H** = Horizontal clearance
4.6m (15 ft) required by Rule 234F1b
- T** = Transition clearance


- V₁** = Vertical clearance above a building required by Rule 234C
- V₂** = Vertical clearance required by Rule 232B

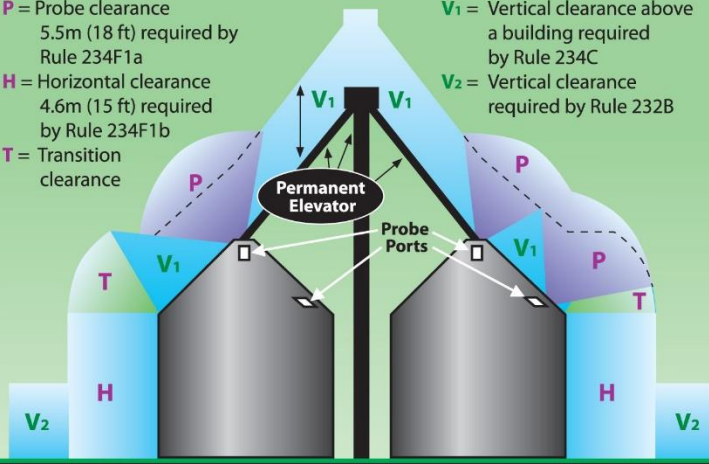

From IEEE Std. C2-2012, "National Electrical Safety Code."

Clearance envelope for grain bins filled by portable augers, conveyors or elevators

ELEVATION

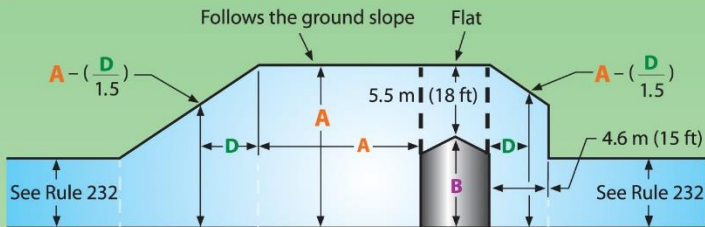


- B** = Height of highest filling or probing port on grain bin
- A** = B + 5.5m (18 ft)
- D** = Variable horizontal dimension

In the area of sloped clearance, the vertical clearance is reduced by 300mm (1 ft) for each additional 450mm (1.5 ft) of horizontal distance from the grain bin.

PLAN VIEW

LOADING SIDE

See Rule 232
Area of sloped clearance

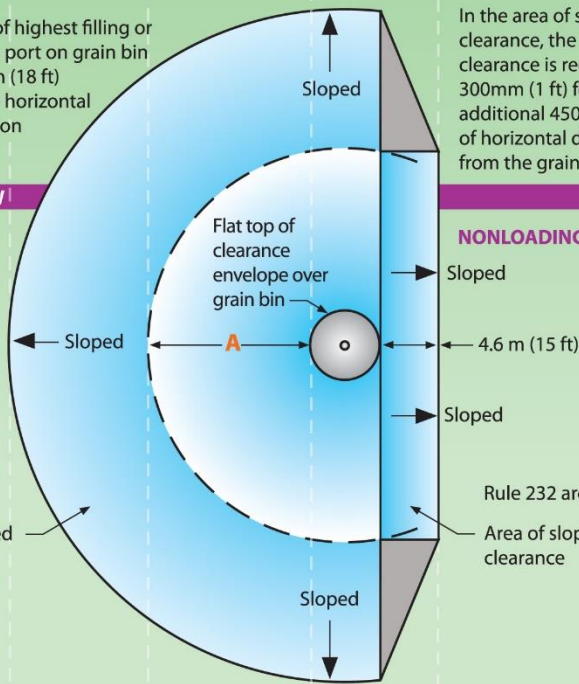

NONLOADING SIDE

4.6 m (15 ft)
Rule 232 area
Area of sloped clearance

From IEEE Std. C2-2012, "Errata to 2012 Edition National Electrical Safety Code." ©Copyright 2013 by IEEE. All rights reserved. The IEEE disclaims any responsibility or liability resulting from the placement and use in the described manner.

Disclaimer: These drawings are provided as part of Iowa electric cooperatives' annual public information campaign and are based on the 2012 Edition of the NESC as corrected. To view the actual drawings refer to 2012 Edition National Electrical Safety Code and the Errata to 2012 Edition National Electrical Safety Code Correction Sheet issued April 29, 2013. Every care has been taken for the correctness of the contents of these drawings. However, the IAEC and its member cooperatives accept no liability whatsoever for omissions or errors, technical inaccuracies, typographical mistakes or for damages of any kind arising from the use of the contents of these drawings, whether textual or graphical.